

TYPE FT-1 FLEXITEST SWITCH, SWITCH ARRANGEMENT & INTERNAL SCHEMATIC

REF.
10 POS SW.
UPPER SECTION
FRONT VIEW
(CVR REMOVED)




POLE
POSITIONS

SWITCH
ARRANGEMENT

INTERNAL
SCHEMATIC

TERMINAL NO.s
(REAR OF SW)

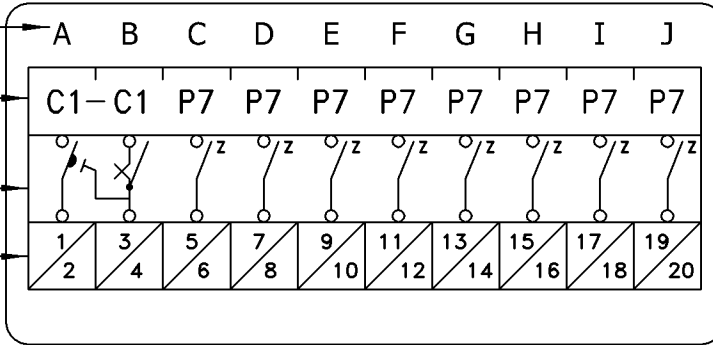

ARRANGEMENT: C-C Z Z Z Z Z Z Z Z

STYLE No: 991A944G01

CODE No: 944

CLASS 1E: NO

No. POLES: 10

No. POTENTIALS: 8

No. CURRENTS: 2

TIE BARS: NONE

DRILL PLAN: 129A500

INT SCHEMATIC: 991A944

Table 1 - Description of Poles for FT Flexitest Switches

Pole Type	Pole Designation		Handle Color	Description & Schematic Symbol
Potential	P1	P	Black [†]	Potential, non-shorting blade.
Current	C1	C	Black [†]	Current, non-shorting, with test jack and blade.
Current †† Shorting	C1-C1	C-C	Black [†]	Current shorting (make-before-break), with test jack and blade.
	C1-A1	C-A		Current shorting (make-before-break), with blade only.
	C1-B0	C-B		Current shorting (make-before-break), with stud only.
	C1-D0	C-D		Current shorting (make-before-break), with test jack only.
	C1-E1	C-E		Current shorting (make-before-break), with shorting blade only.
	C1-S0	C-S		Current shorting (make-before-break), with fixed shorting strap.
Other	D0	D	None	Current test jack, no blade.
	S0	S	None	Fixed shorting strap.
	X0	X	None	Empty pole position.

Table 2 – Handle Colors

Pole Type	Pole Designation		Handle Color
Potential	P1	P	Black
	P2	T	Red
	P3	H	Brown
	P4	V	Purple
	P5	G	Green
	P6	Y	Yellow
	P7	Z	Blue
	P8	W	White
	P9	O	Orange
Current	C1	C	Black
	C2	R	Red
	C3	3	Brown
	C4	4	Purple
	C5	5	Green
	C6	6	Yellow
	C7	7	Blue
	C8	8	White
	C9	9	Orange

TEST PLUGS:

INDIVIDUAL CURRENT CIRCUIT TEST PLUG.
STYLE No: 7B4618G04

SEPARATE SOURCE TEST PLUG (10 POS).
STYLE No: 1164046

IN-SERVICE SERIES TEST PLUG.
STYLE No: NONE

ECO EM2007-1079 1

The information contained in this document has to be kept strictly confidential. Any unauthorized use, reproduction, distribution or disclosure to third parties is strictly forbidden.
ABB reserves all rights regarding Intellectual Property Rights.

SOFTWARE TYPE:
AUTOCAD 2006

ENG. REF: MFG DWG: FT1-944
GEN DWG: 1616C24

DATE: R.Novoseletsky 10/1/2007
CHKR: M.Uriguen 10/1/2007
APPR: Tim Masters 10/1/2007



TITLE:
FT-1 SWITCH
POLE ARRANGEMENT & INT SCH

© Copyright 2007 ABB
All rights reserved

SIZE: A
DWG. NO: 991A944
REV: 1

ABB Protective Relays and Switches, Coral Springs Fl, U.S.A.

SCALE: NONE SHEET 1 OF 1